LX/LX-LC

941039-00

Switch Retrofit Kit

VON DUPRIN

Installation Instructions

This kit includes the following parts:

LX { This switch is intended for signaling purposes only and is rated for a maximum 2 ampere resistive load at 24VDC/AC. Use with inductive or capacitive loads (magnetic locks or solenoid devices) derates the capacity of the switch. Consult the factory for assistance.

LX/LC { This switch is intended for systems using low current signals. The switch is rated for a maximum of 50mA. Consult the factory for assistance.

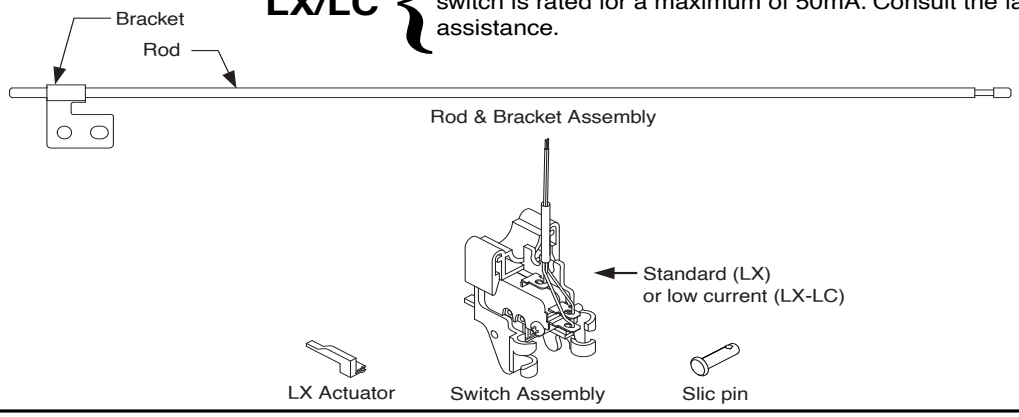

Step 1 Disassemble the device. (Remove from door if mounted.)

22 Device

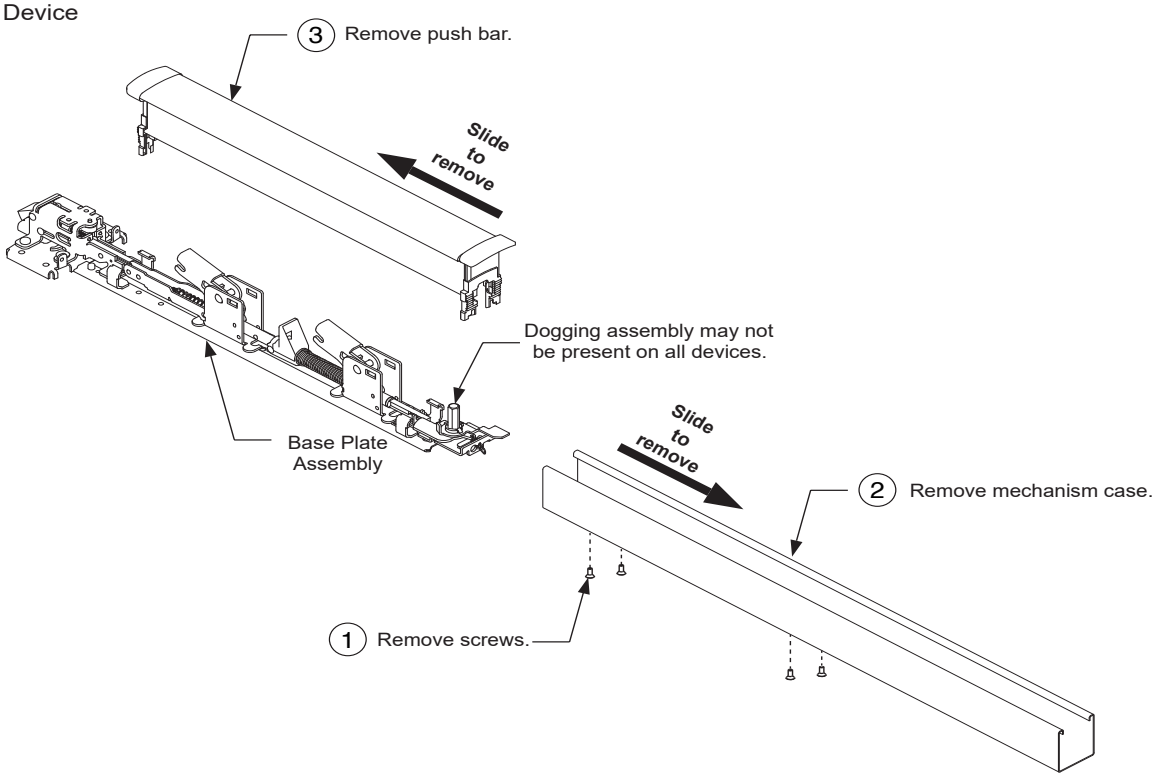

ALLEGION

Customer Service

1-877-671-7011 www.allegion.com/us

© Allegion 2026
Printed in U.S.A.
941039-00 Rev. 04/26-d

Step 1 continued Disassemble the device. (Remove from door if mounted.)

33a/35a Device

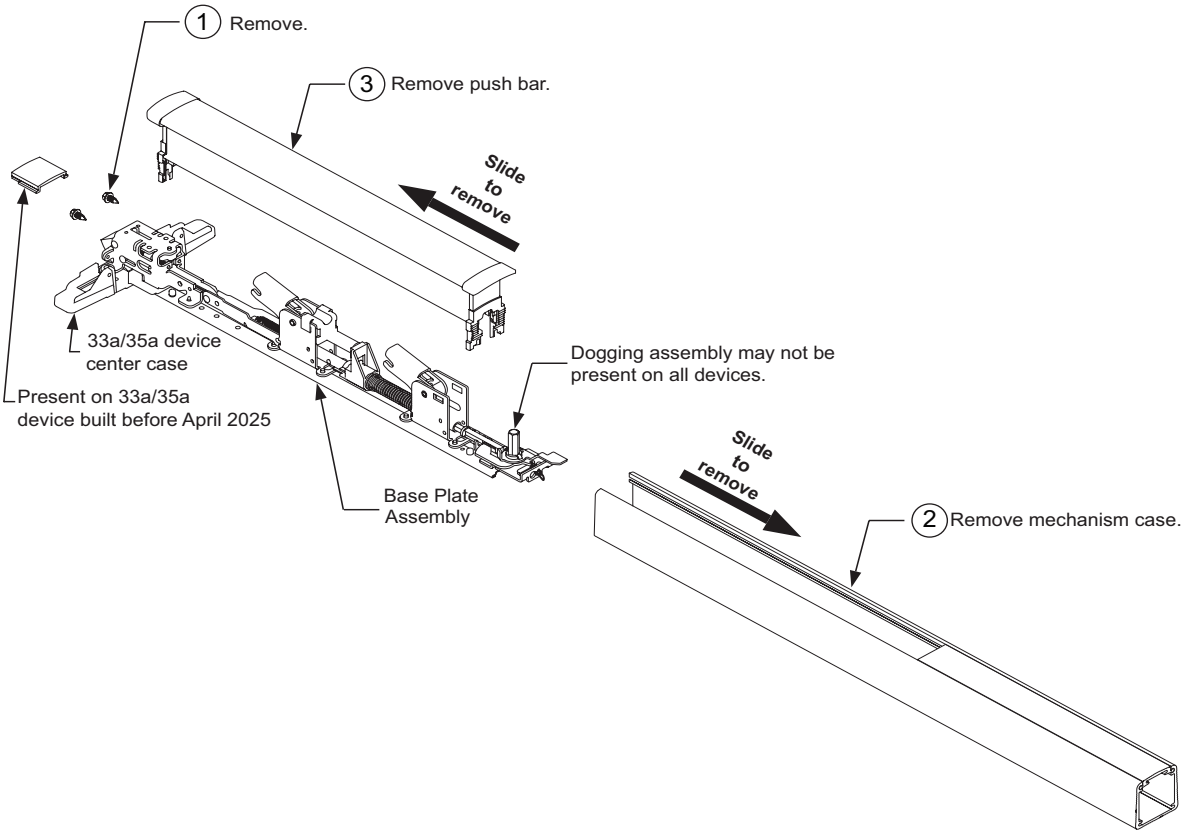

98/99 Device

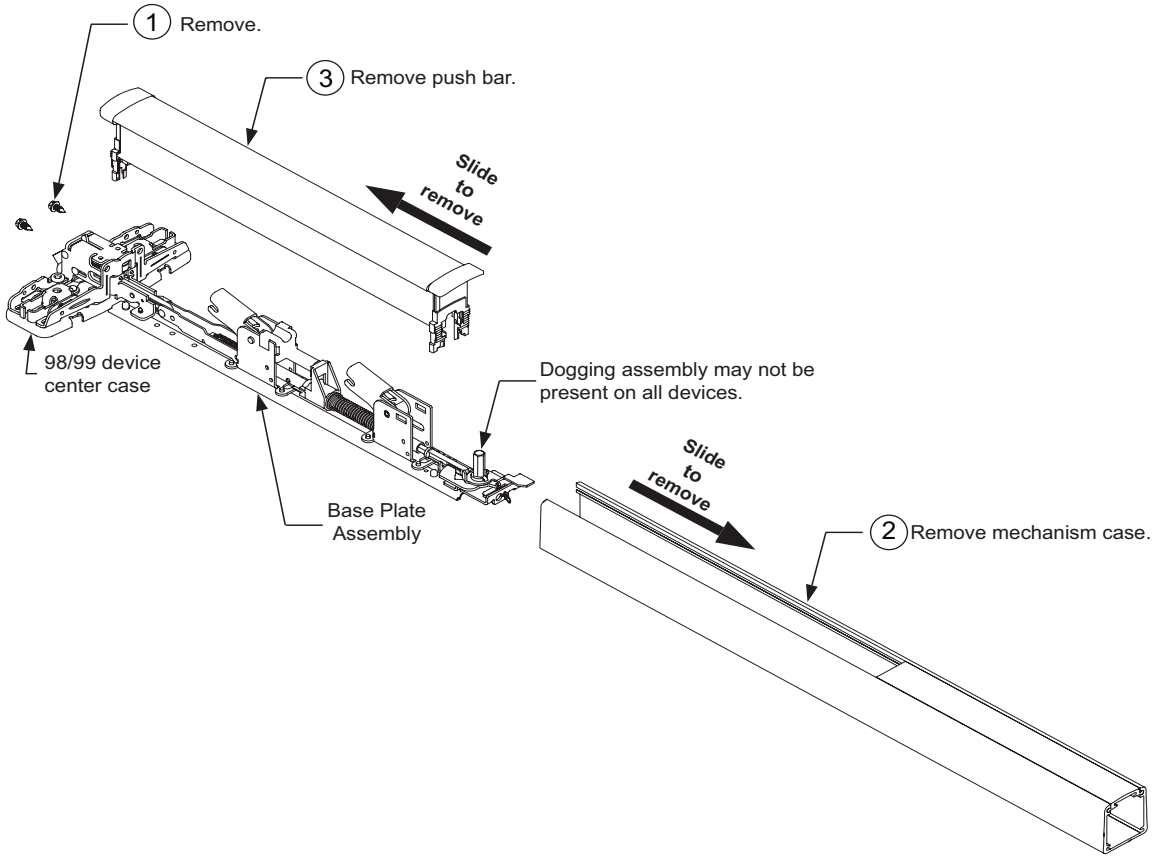

Step 2 Install Switch

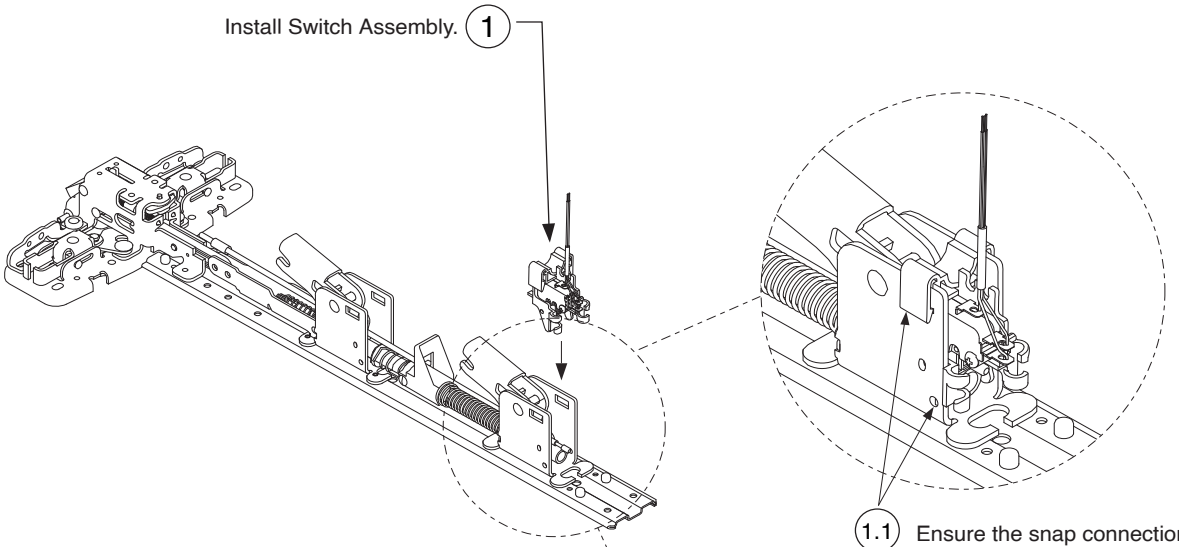

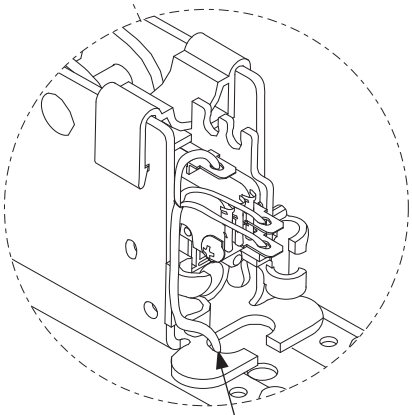

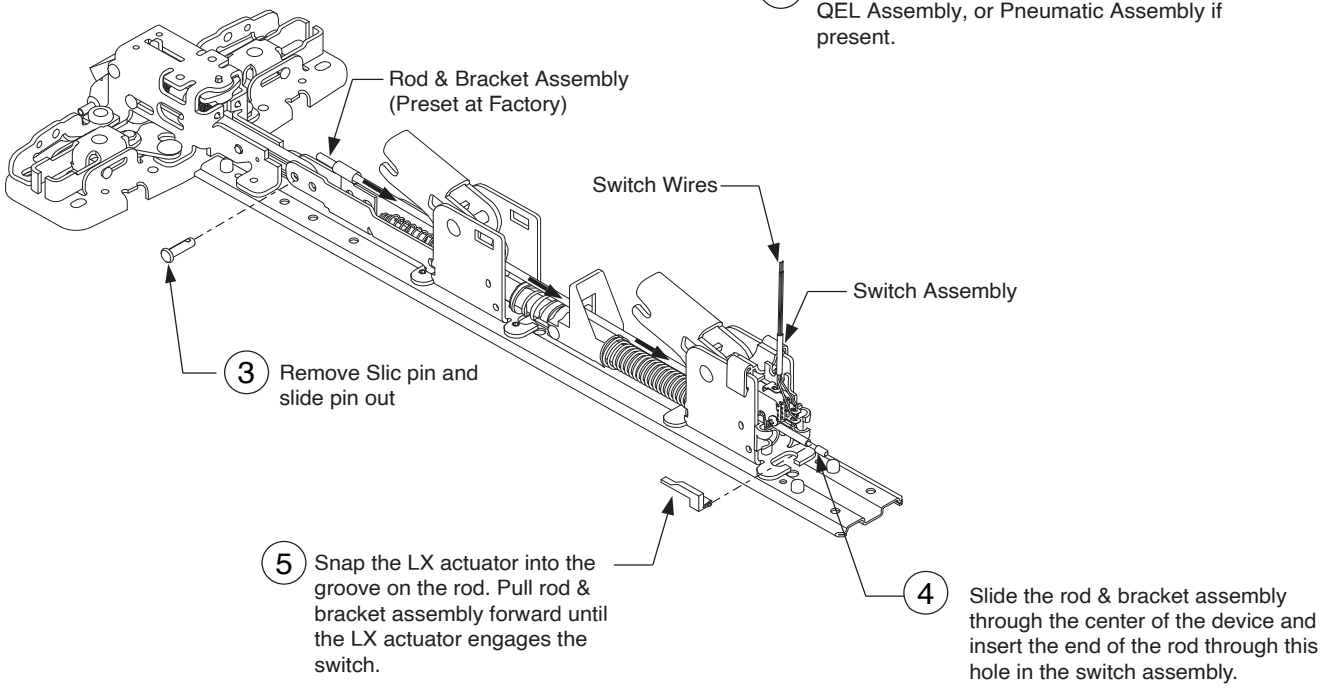

Step 3 Attach Slic pin

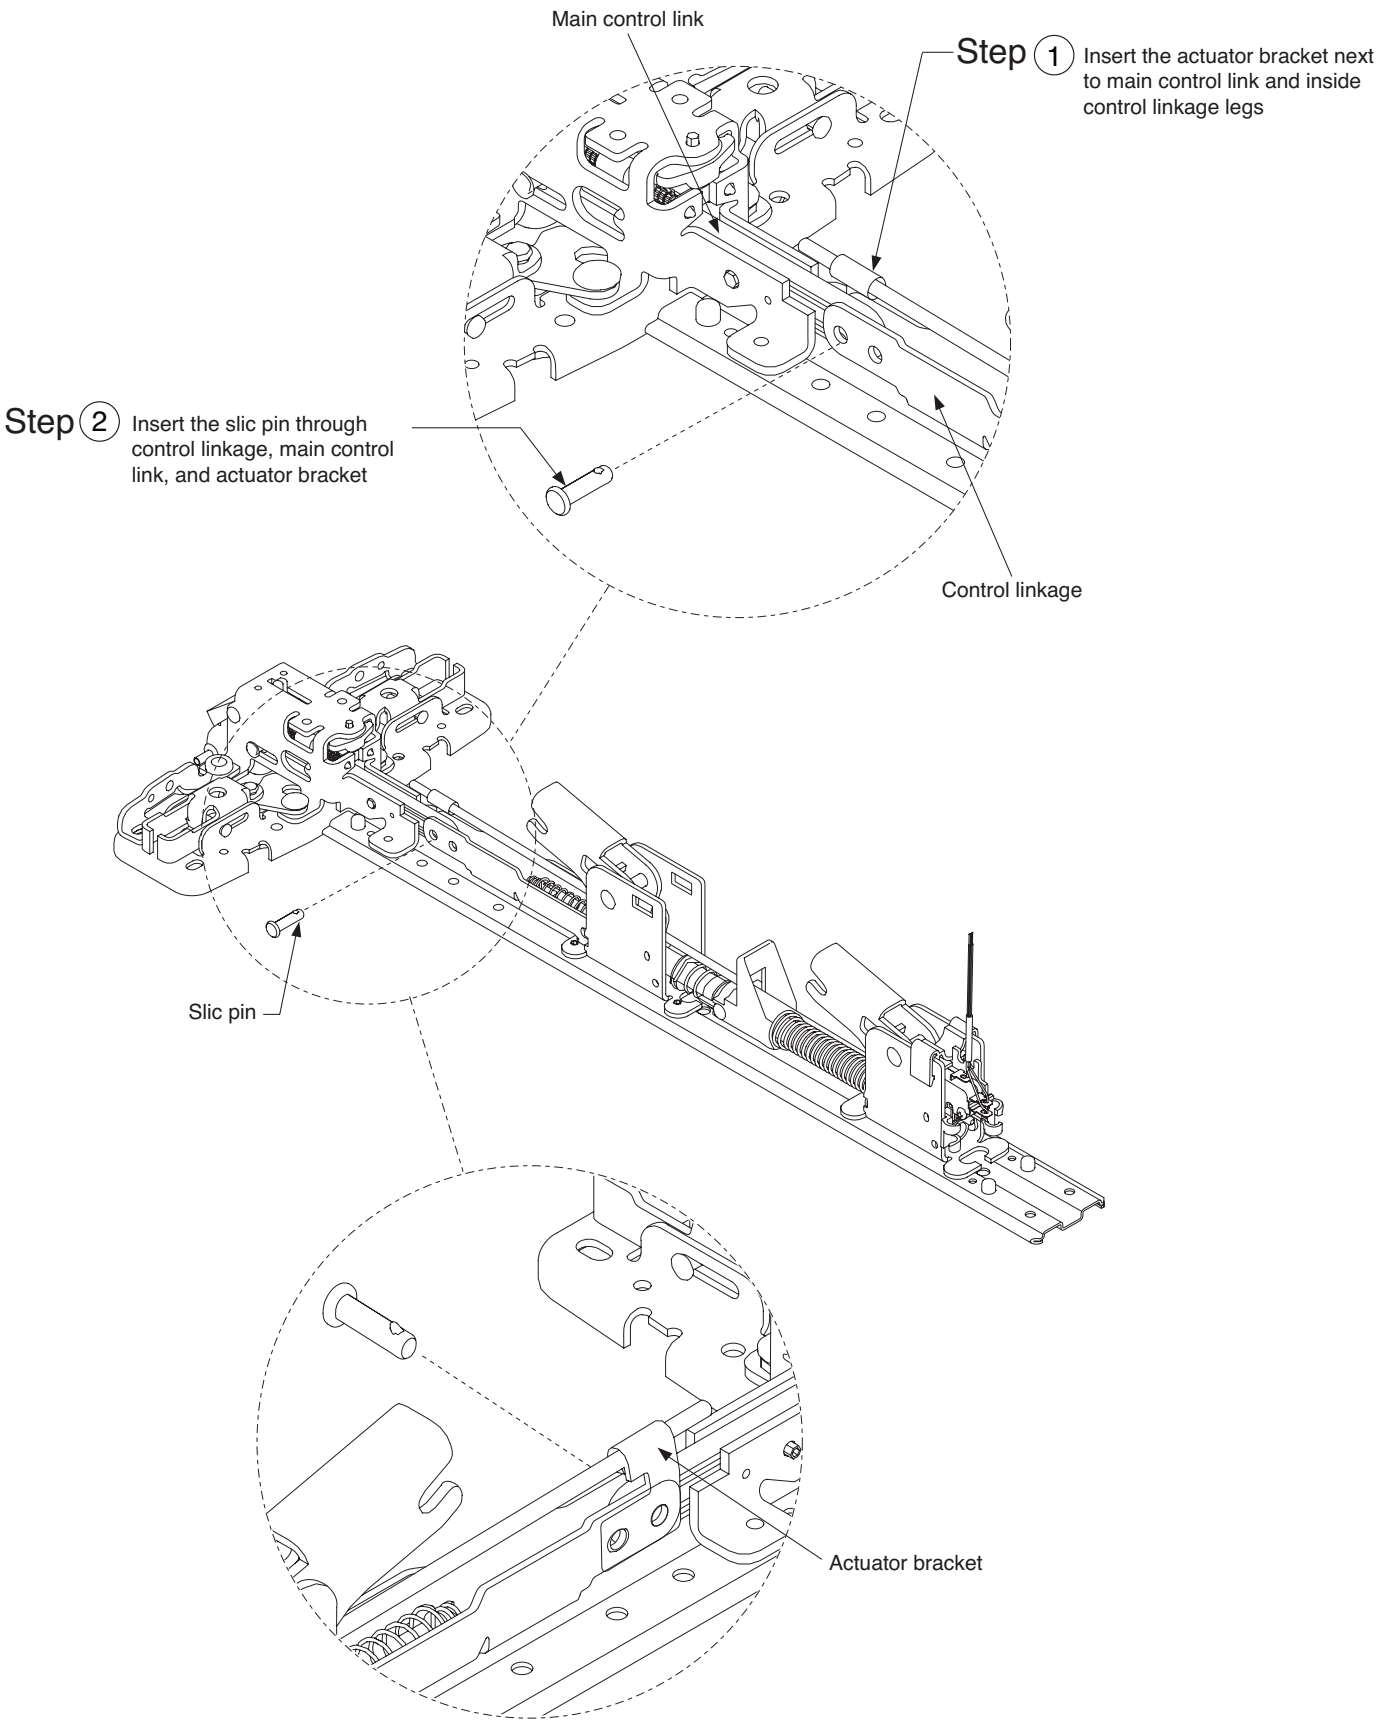

Step 4 Check the switch for proper actuation

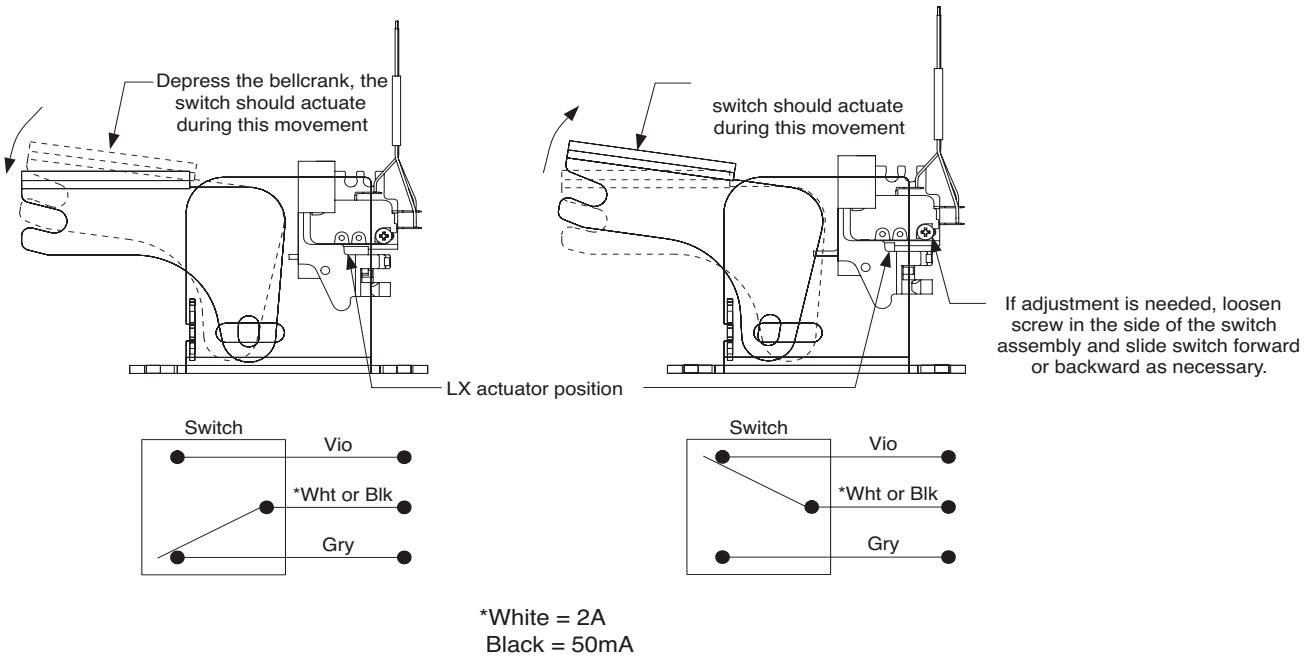

*White = 2A
Black = 50mA

Step 5 Prepare door for device wiring.
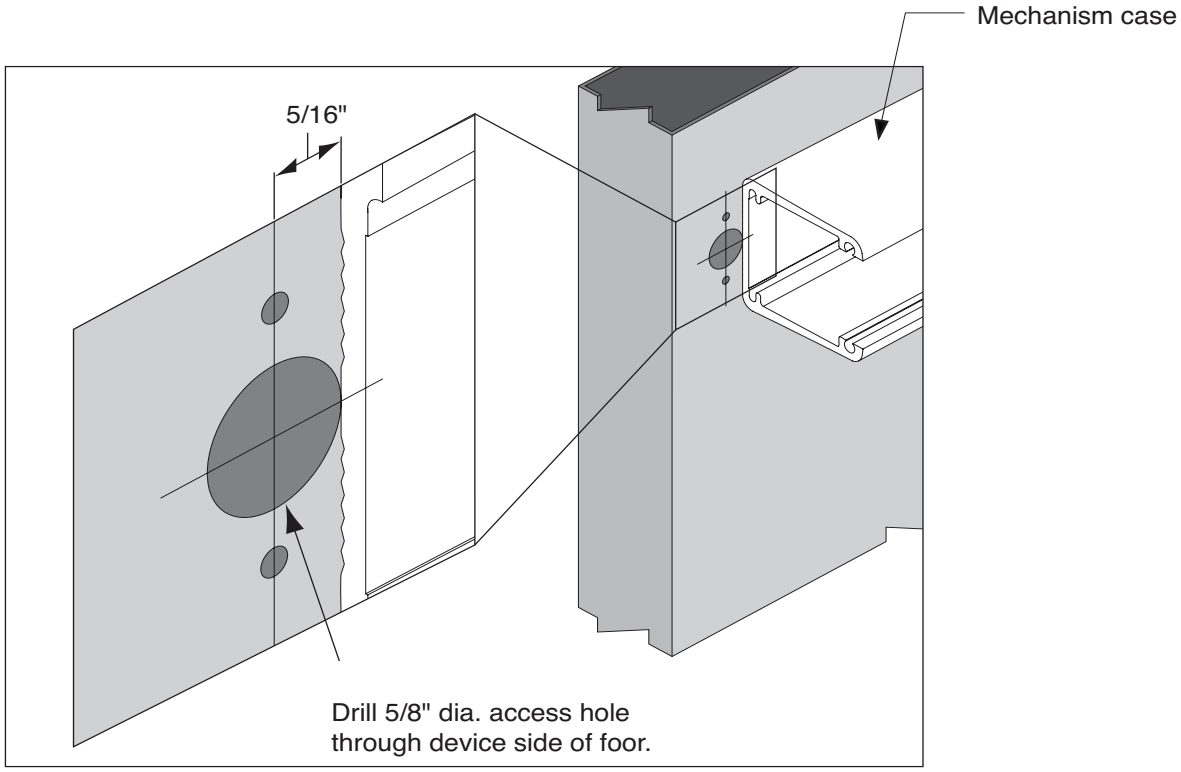
Drill Wire Access Hole