941038-00

Switch Retrofit Kit

RX/RX-LC/S1

VON DUPRIN®

Installation Instructions

This kit includes the following parts:

RX { **This switch is intended for signaling purposes only and is rated for a maximum 2 ampere resistive load at 24VDC/AC. Use with inductive or capacitive loads (magnetic locks or solenoid devices) derates the capacity of the switch. Consult the factory for assistance.**

RX-LC { **This switch is intended for systems using low current signals. The switch is rated for a maximum of 50mA. Consult the factory for assistance.**

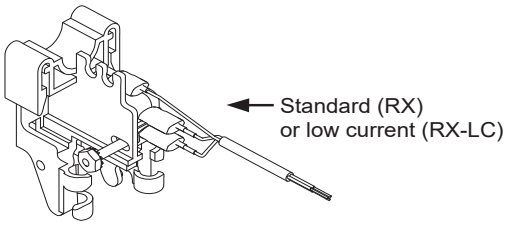

Switch Assembly

Step 1 Disassemble the device. (Remove from door if mounted.)

22 Device

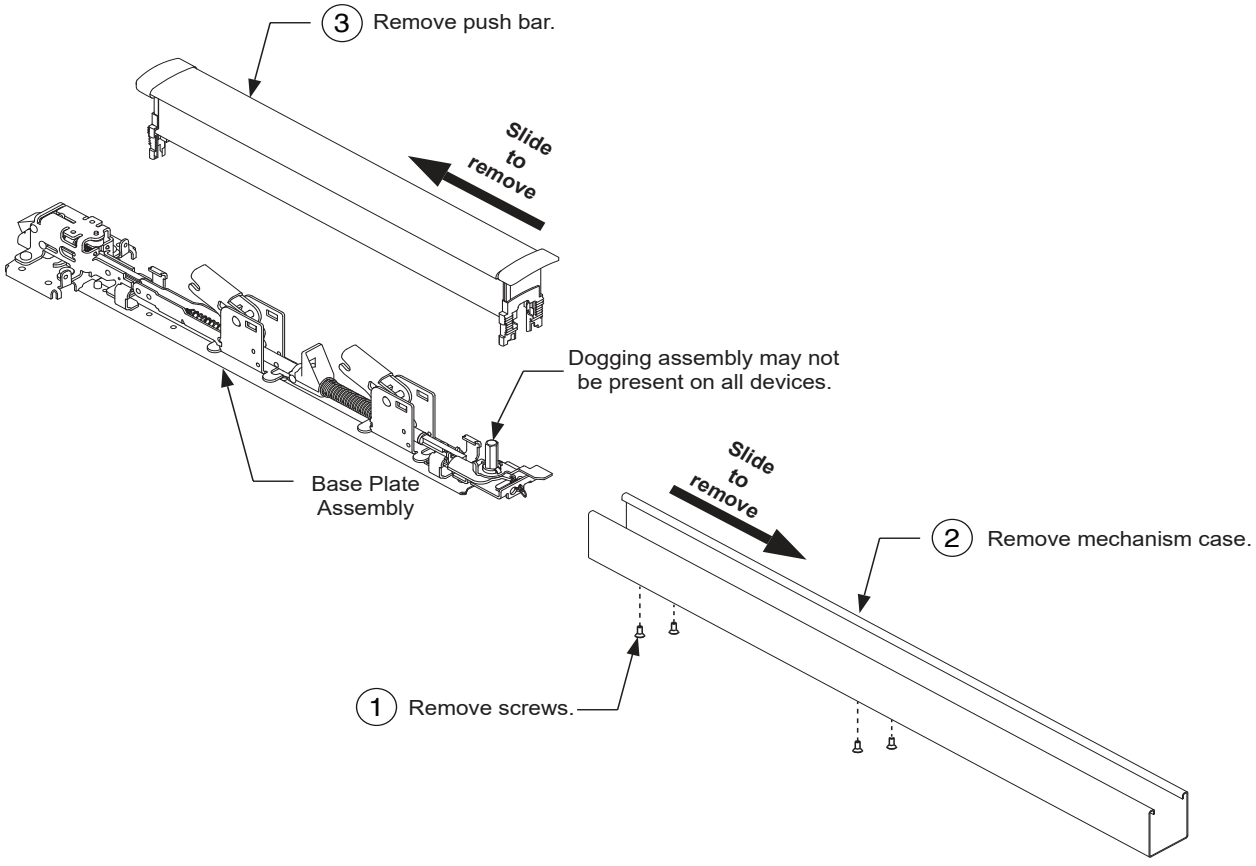

ALLEGION

Customer Service

1-877-671-7011 www.allegion.com/us

© Allegion 2026
Printed in U.S.A.
941038-00 Rev. 04/26-d

Step 1 Continued

33a/35a Device

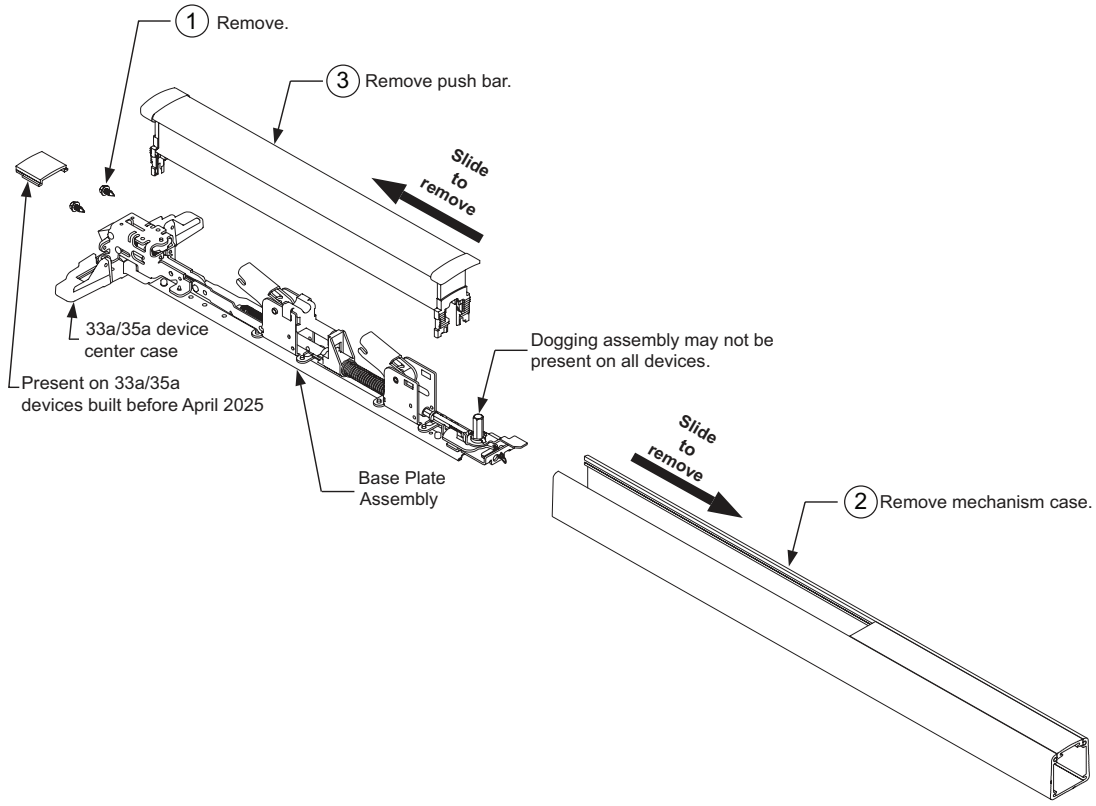

98/99 Device

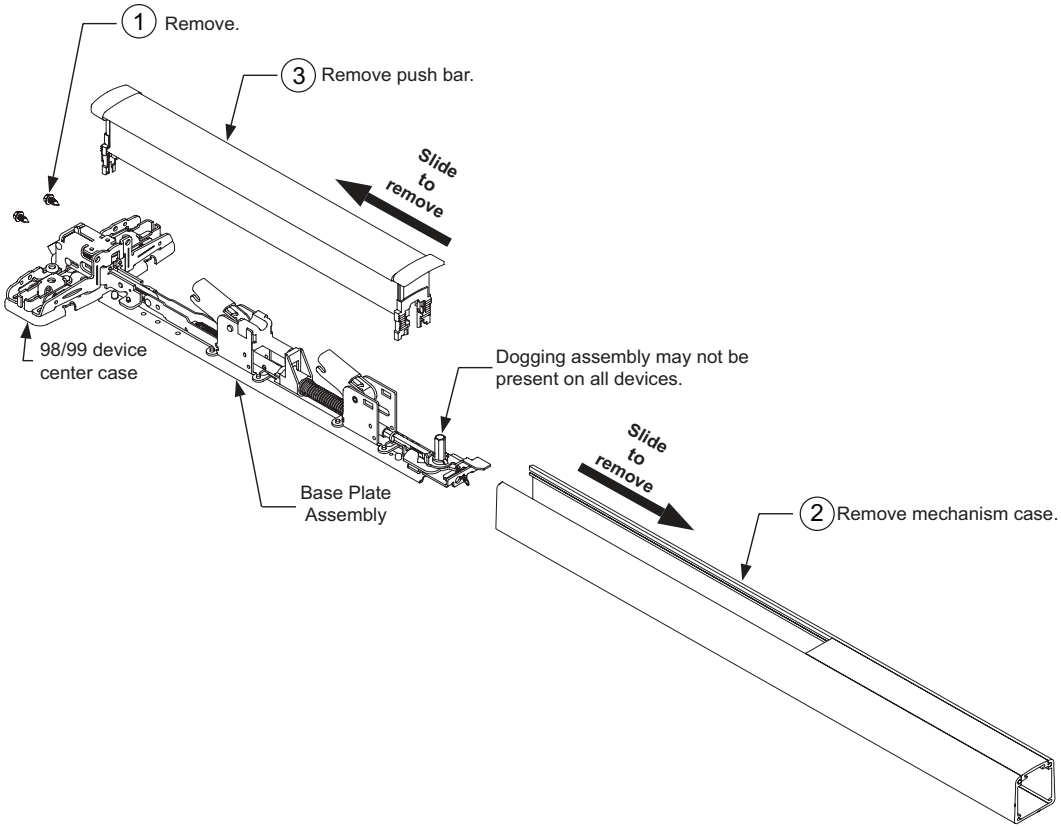

Step 2 Install Switch

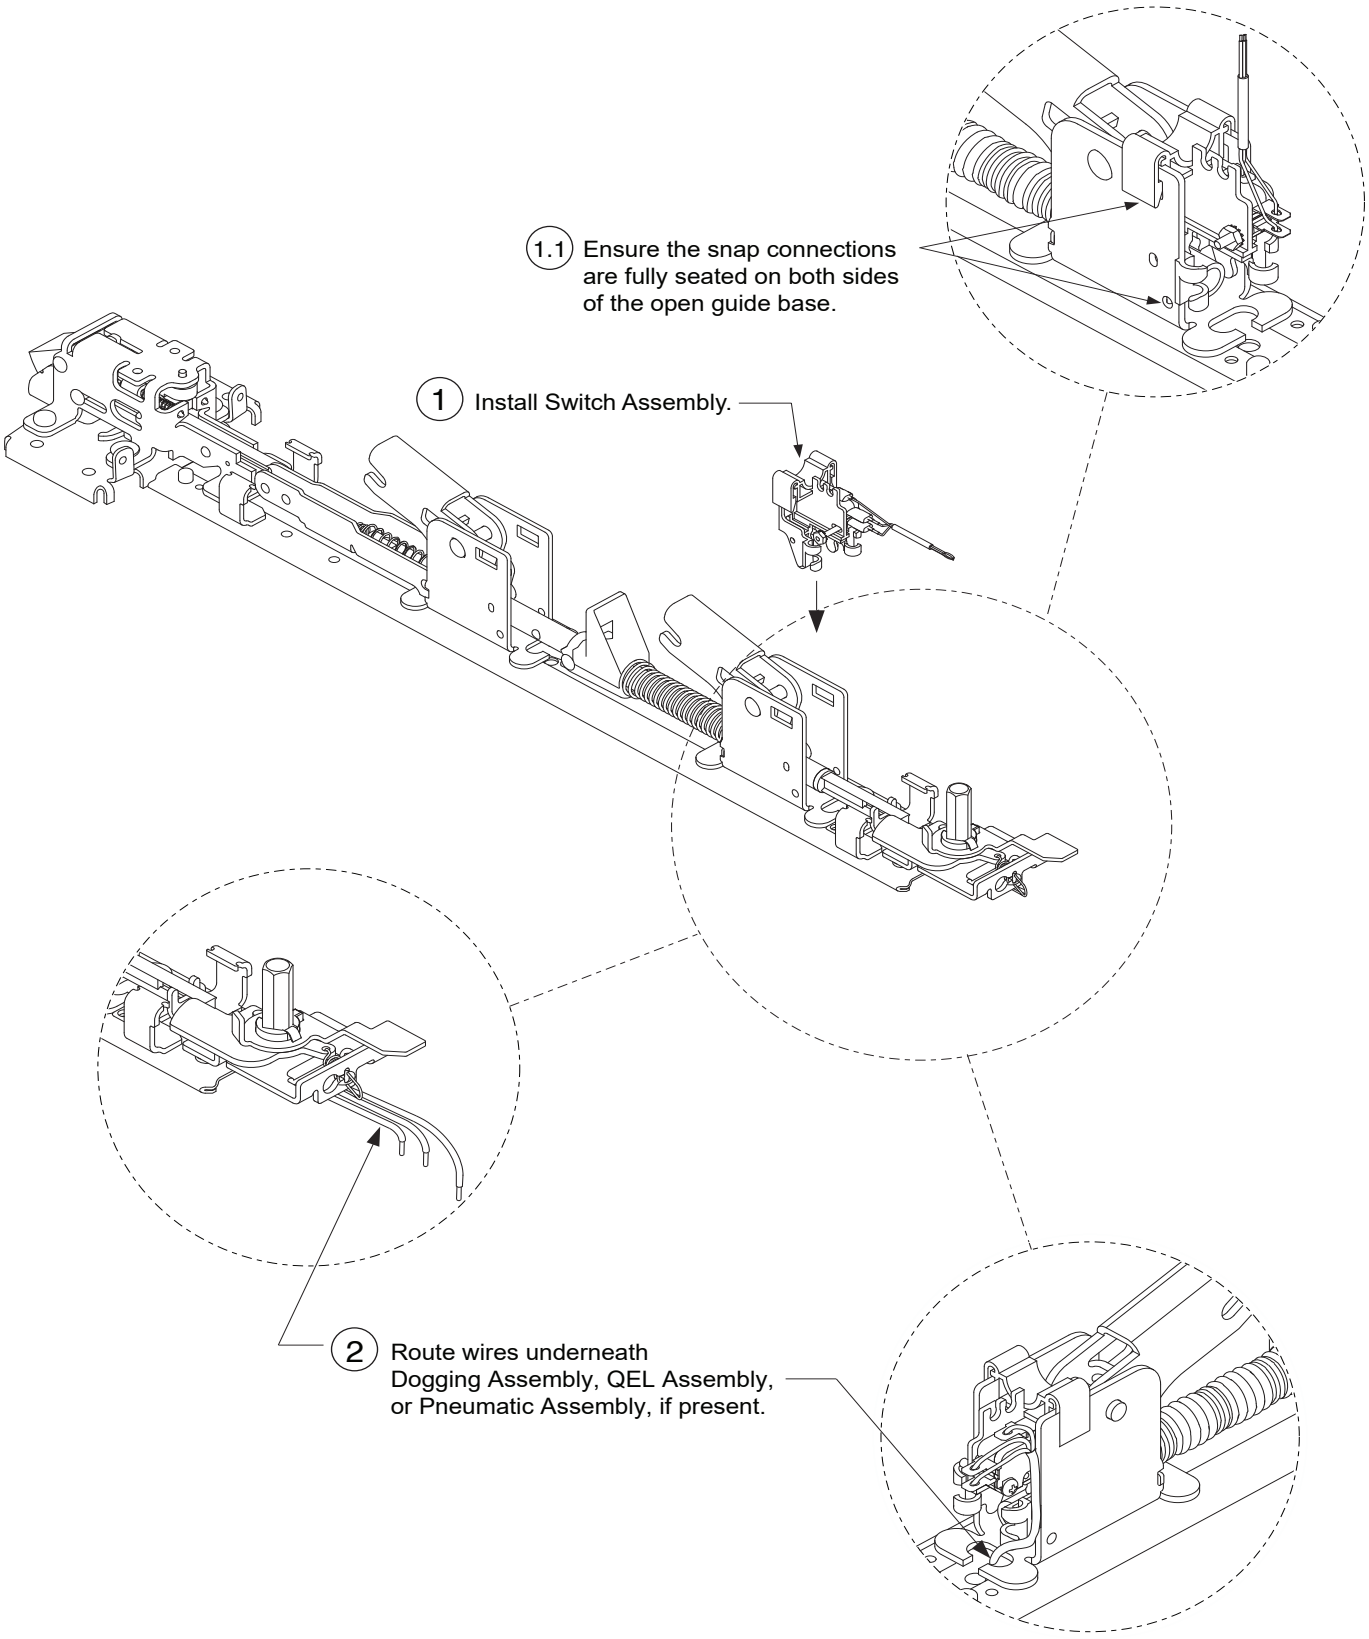

Step 3 Check the switch for proper actuation.

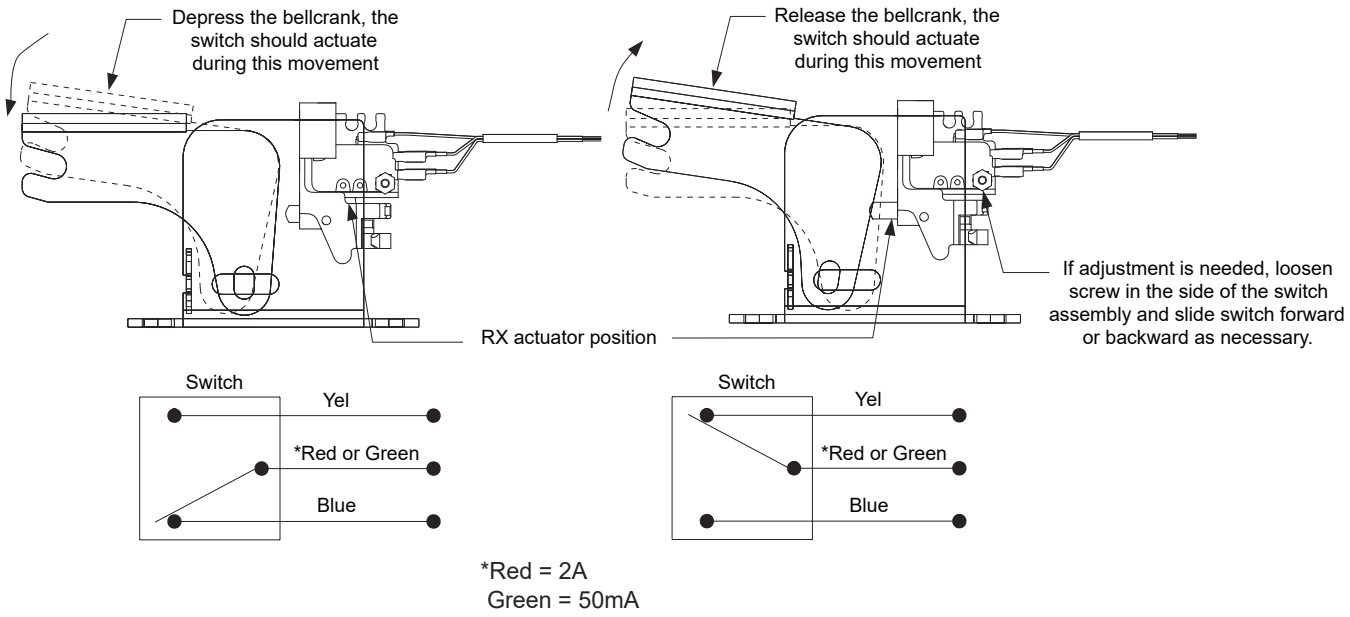

*Red = 2A
Green = 50mA

Step 4 Prepare door for device wiring.
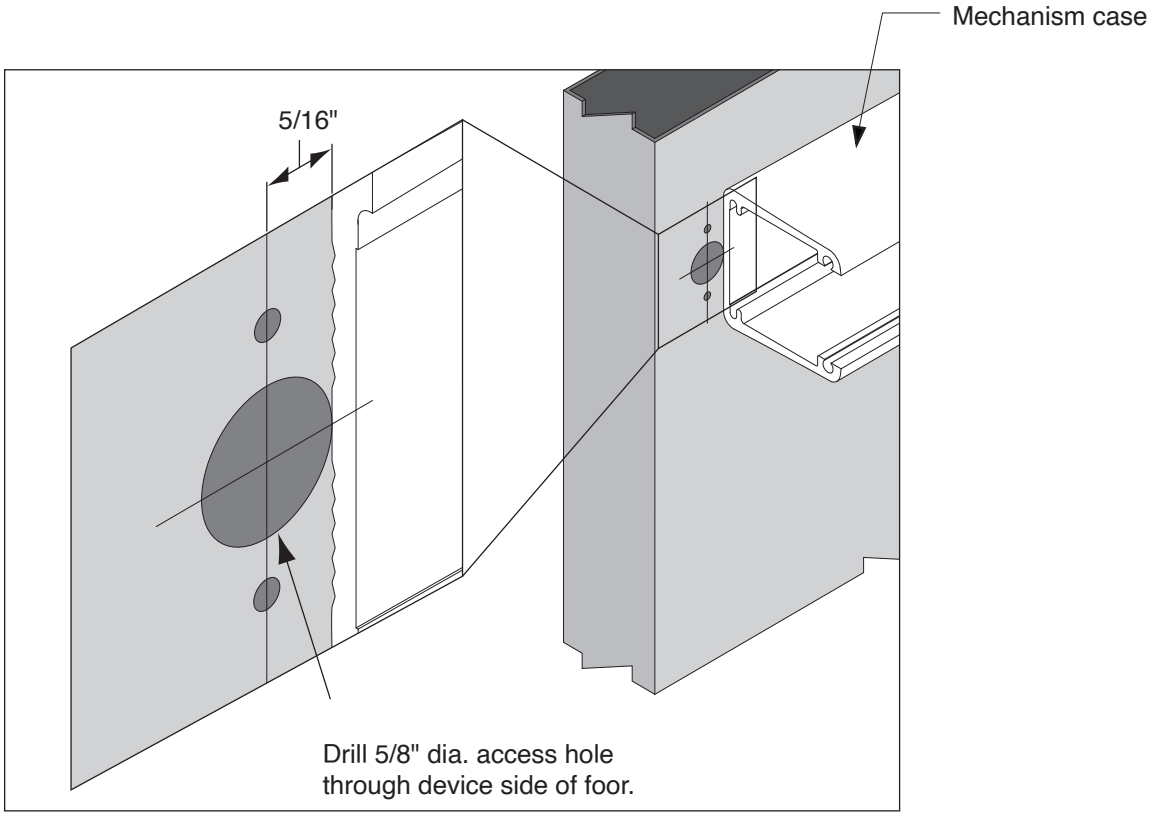
Drill Wire Access Hole